
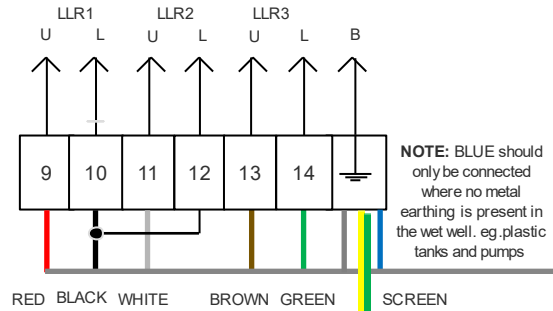
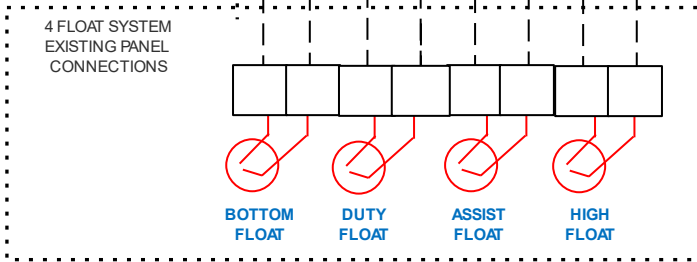



2, 3 or 4 Ball Float Replacement FOGRod Retrofit Box

CAUTION 240V
ISOLATE SITE MAINS SUPPLY
BEFORE WORKING ON THIS PANEL

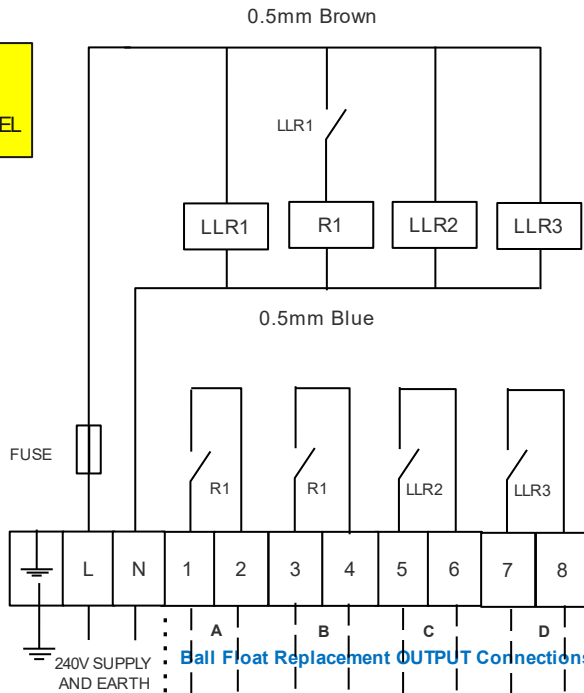

IMPORTANT
REFER TO FOGRod
installation guide

5 ELECTRODE FOGRod

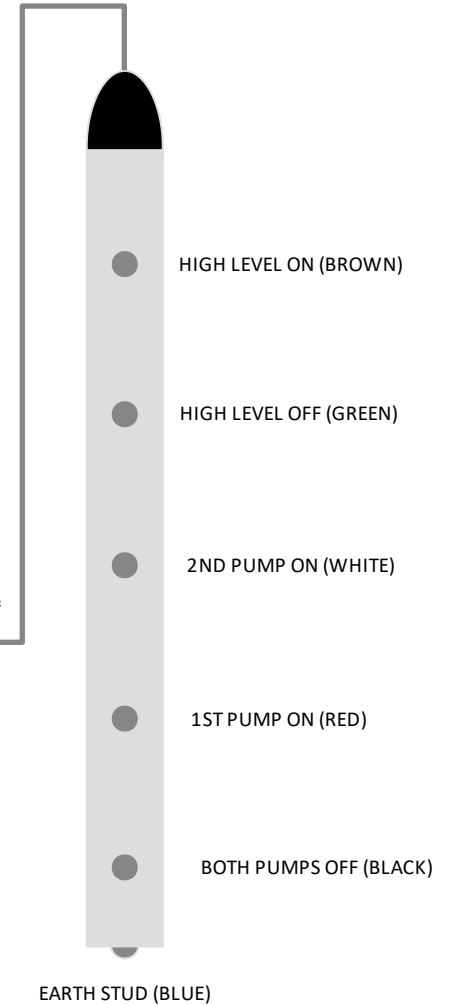

DANGER
VOLTAGES FROM OTHER
SOURCES PRESENT ON
TERMINALS 1 TO 8, ISOLATE
ELSEWHERE PRIOR TO
COMMENCING ANY WORK.

NOTES

1. IF YOU REQUIRE CLOSER ELECTRODES AND/OR A LARGER SELECTION OF ON/OFF POINTS USE A 10 ELECTRODE FOGRod
2. RELAY OUTPUTS 240V AC MAX 8A RESISTIVE LOAD, MAX 2A INDUCTIVE LOAD.
3. FOR A 3 FLOAT SYSTEM CONNECT 3 & 4 (B - DUTY FLOAT). 5 & 6 (C - ASSIST FLOAT), 7 & 8 (D - HIGH FLOAT)
4. FOR A 2 FLOAT SYSTEM CONNECT 3 & 4 (B - DUTY FLOAT), 7 & 8 (D - HIGH FLOAT)